(6)

SRI BAALAMURUGAN BOREWELLS

4, gangamma Compound, Opp. Canara Bank Bus Stop, Bellary Main Road, Helbal Bangalore - 24
Mob : 9845020536, 9901920004

WORK REPORT

			No.	
Amsedibes nagara 2nd cross.			Date : 30-3-15.	
S.No.	Particulars	Rft :	Water Yield	Remarks
1.	Size of The Borewell	165mm		
2.	Total Deapth of The Borewell	294'		
3.	MS Casing Erected	186'		
4.	1st Water Source at the Deapth	300'		
5.	2nd Water Source at the Deapth	510'		
6.	3rd Water Source at the Deapth	780'		
7.	4th Water Source at the Deapth	910'		
8.	If any Silt, Boulders at the Deapth	—		
9.	Nature of Water	Sweet Water		
10.	Moter Pump to be Used	15 HP 30 Stage		
11.	Any other Remarks	—		
12.	Total Yield of the Borewell	2'. 3"		

Thanking You

Yours faithfully
For Sri Baalamurugan Borewells

(5)

GROUND WATER SURVEY REPORT

OPEN WELL/ BOREWELL
DATA OF SURVEY

a) Name of the Party : AEE, Byatarayanapura. Sub Division.

b) Location of the Site : BBMP Ward No-5

c) Area of the land : Kattigenahalli Ambedkar nagara.

INVESTIGATION REPORT

1) GEOLOGY OF THE AREA :

2) Recommended Site for drilling :

3) Total depth to be drilled : 800'.0" to 1190'.0"

4) Approx. casing pipe required : 90'.0" to 195'-0"

5) No. of water bearing Zones : —1—

6) No. of favourable spots marked : —1—

7) Qty. of water expected : 2.0' to 2.50"

8) Method of survey carried out : - Geo -

9) Remarks : —

HYDROGEOLOGIST
(M.G. RAJASHEKHAR, M.Sc., DEG., F.G.S.)

P.T.O. : Terms & Conditions

BOREWELL SITE PLAN

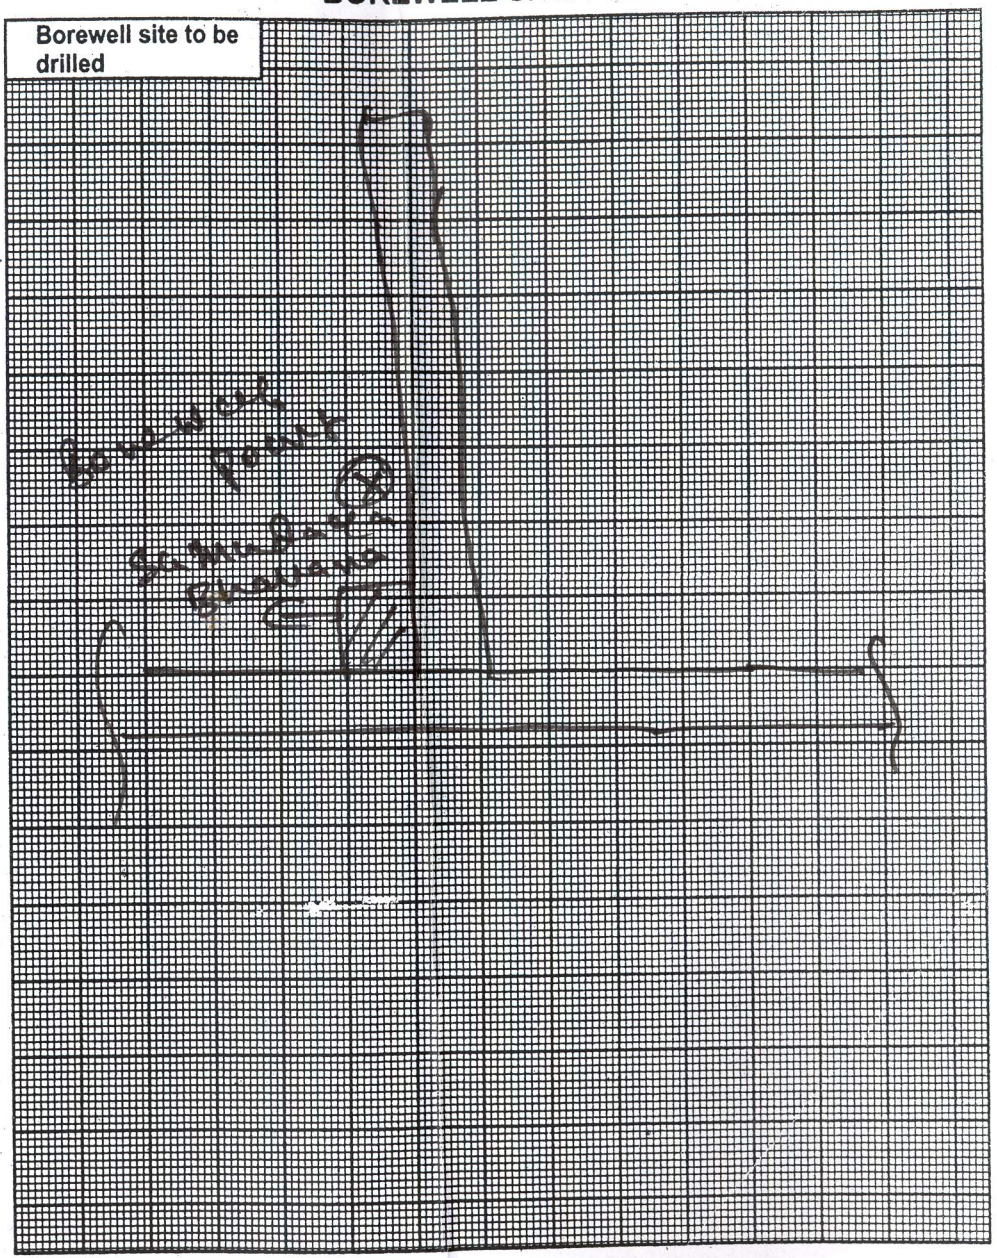

Muster at Thirumenahalli Sri Ramadhu Sathyanarayana Swamy Temple
Palanahalli Ward No-5

ತಿರುಮೇನಹಳ್ಳಿ ಪಲನಹಳ್ಳಿ ವಾರ್ಡ್ ನಂ-5

W-5

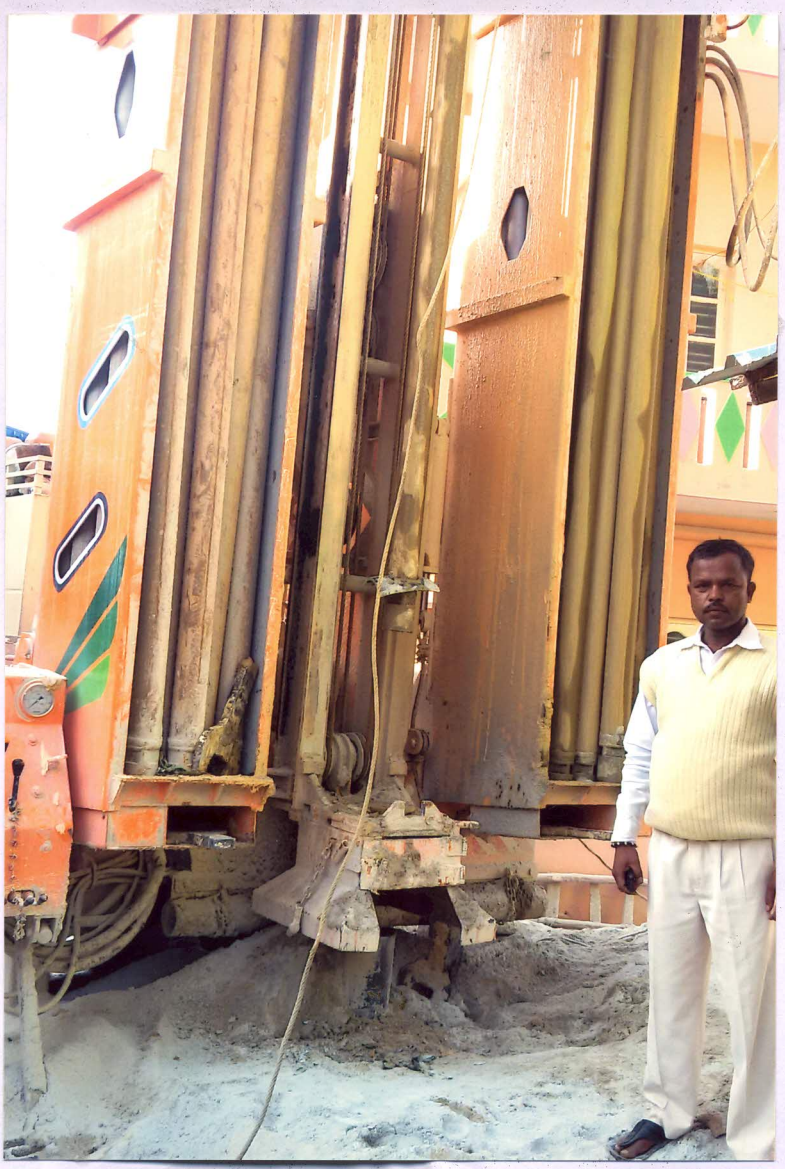

ಸಹಾಯಕ ಅಭಿಯಂತರರು
ಬಿ.ಬಿ.ಎಂ.ಪಿ. ಬ್ಯಾಟರಾಯನಪುರ ಉಪ ವಿಭಾಗ

Assistant Executive Engineer
Byatarayanapura Sub Division
B.B.M.P. Bangalore

Yelahanka New Town, Bangalore-64

ಉಪವಿಭಾಗ

ರಕ್ಷಣೆಗಾಗಿ ಹಳ್ಳಿ ಅಂಬಲಕ್ಕಿ ನಗರ

(3)

ಸಹಾಯಕ ಅಭಿಯಂತರರು
ಬಿ.ಬಿ.ಎಂ.ಪಿ. ಬ್ಯಾಟರಾಯನಪುರ ಉಪ ವಿಭಾಗ

Assistant Executive Engineer
Byatarayanapura Sub Division
B.B.M.P Bangalore